Figure S2

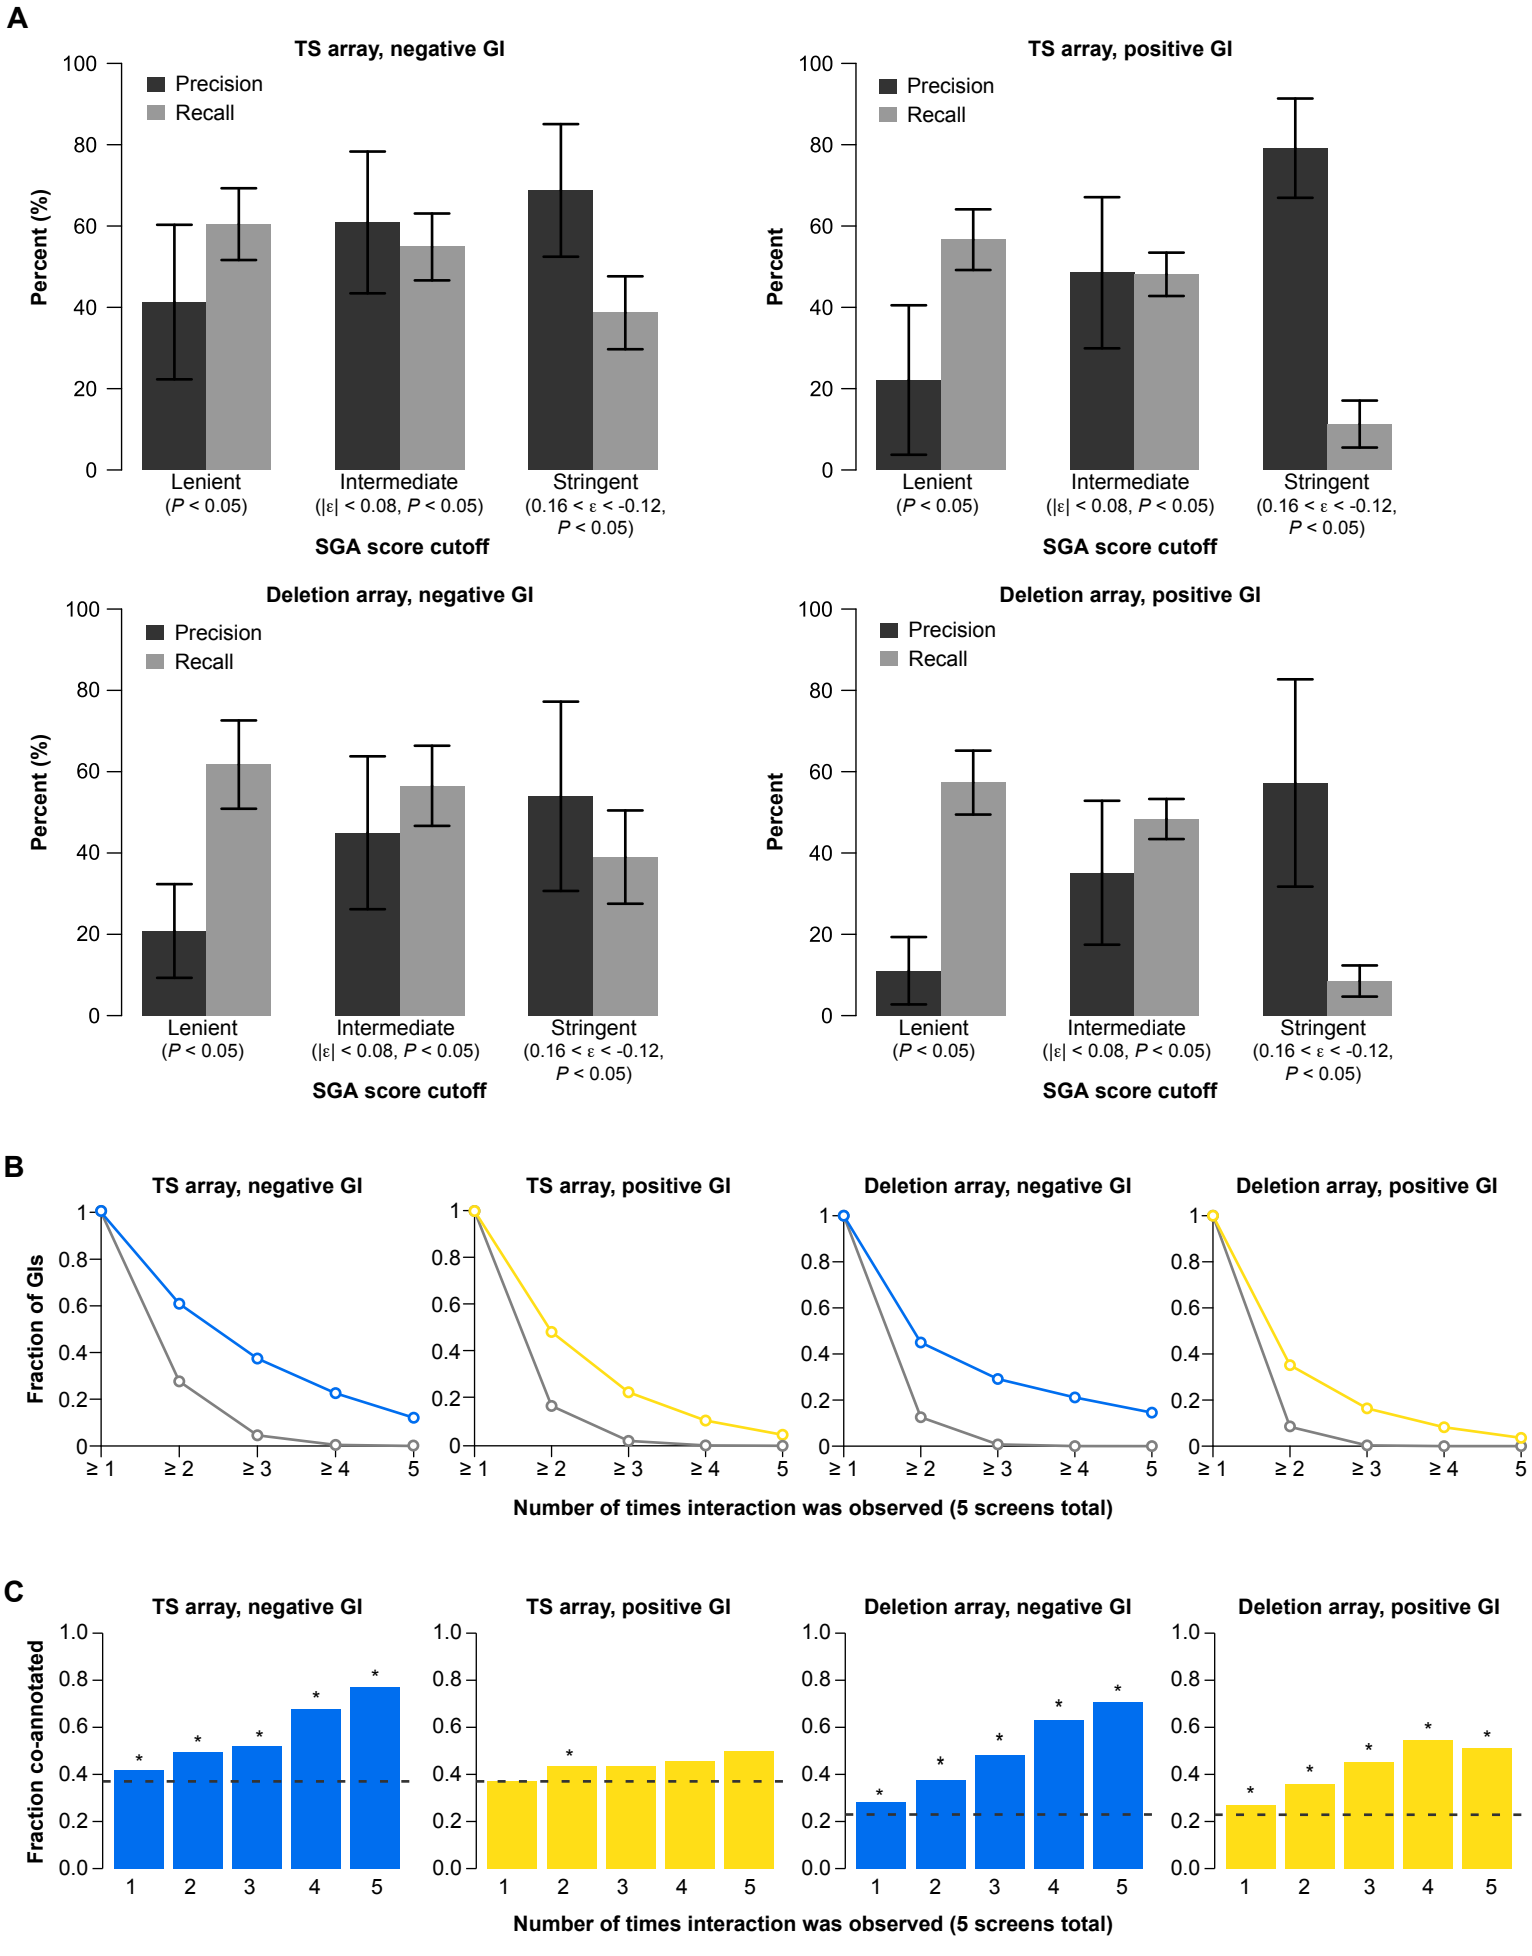
A
TS array, negative GI
TS array, positive GI
Deletion array, negative GI
Deletion array, positive GI
Precision
Recall
Percent (%)
Percent
Lenient
(P < 0.05)
Intermediate
(|ε| < 0.08, P < 0.05)
Stringent
(0.16 < ε < -0.12,
P < 0.05)
SGA score cutoff
B
Fraction of GIs
Number of times interaction was observed (5 screens total)
C
Fraction co-annotated
Number of times interaction was observed (5 screens total)